


DETAIL SECTION

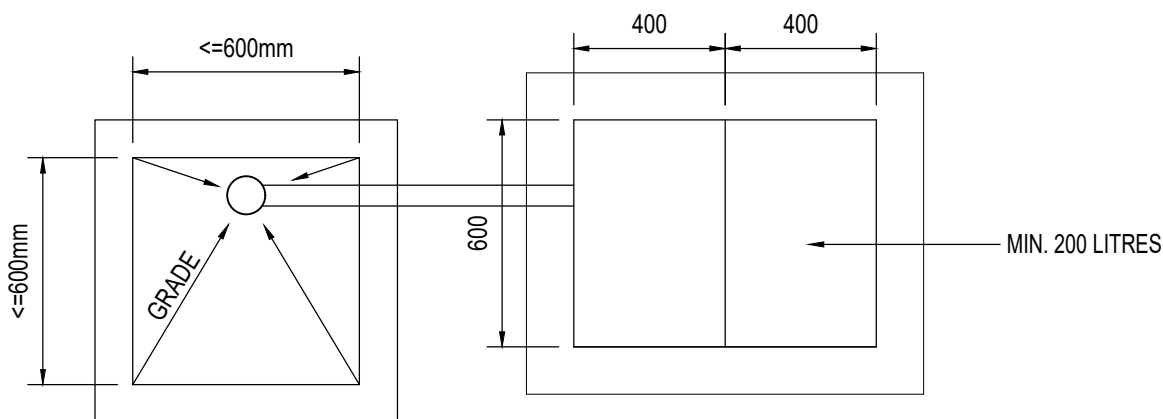

DETAIL PLAN

NOTE:-

- INSTALL A MIN. 100MM OF BEDDING SAND UNDER BASE AND AROUND CRATES BETWEEN GEOTEXTILE LAYER AND EXISTING GROUND. ENSURE TRENCH WALLS ARE SCARIFIED BEFORE INSTALLATION OF MODULAR DRAINAGE CELLS
- WHERE WATER TABLE HIGHER THAN BASE OF ACCESS PIT DRAINAGE SEEK GRIFFITH UNIVERSITY APPROVAL
- RUBBLE FILLED TRENCHES TO BE A MIN. OF 3 TIMES THE CAPACITY OF DRAINAGE CELL (VOID) SIZES INDICATED
- DRAINAGE CELL SIZES SHOWN ARE INDICATIVE ONLY (AUSDRAIN)
- GRATED FLOOR DRAIN OUTLET TO BE POSITIONED CLEAR OF EQUIPMENT IN PIT FOR EASY ACCESS

TITLE
PIT DRAINAGE - <= 600 SQ. PIT

PROJECT:
STANDARD DETAILS
HYDRAULIC SERVICES



PLANNING, DESIGN & CONSTRUCTION
CORPORATE SERVICES

170 KESSELS ROAD, NATHAN, BRISBANE, QLD. 4111 PH:(07) 3735 7111 griffith.edu.au

DATE
11/08/2021

DRAWN BY
WO

SCALE
1:40

APPROVED BY
JA

DISCIPLINE
HYDRAULIC

REVISION
2

PROJECT No:
N/A

DRAWING No:
GSD-806A

SHEET No:
1 of 1